

80-I

134b



K.Dis.No.18024/C1/2024
Dated:28.01.2025

O/o.the Director of Fire & Rescue Service,
No.17, Rukmani Lakshmi Pathi Safai,
Egmore, Chennai - 600 008.

Licence No.43/2025 (Issue)

- Ref: 1) Letter from the **M/s. Dr. R. Gunasekaran MD., DM., Dean (FAC), Govt. Medical College and Hospital, Namakkal**, Dated:06.11.2024.
- 2) Letter R.C.No.2596/A/2024, dated:21.01.2025 from The Chairman, MSB Inspection Committee, **Salem Region, Salem**

With reference to the letter first cited above the Fire Licence is **issued** as under, based on the recommendations conveyed in the reference 2nd cited above.

FIRE & RESCUE SERVICES LICENCE

The Fire Licence is hereby **issued** under section 13 of the Tamil Nadu Fire and Rescue Service Act 1985 for the multi-storied building classified as **Group C Industrial Building, Sub-Division C-1 Hospitals and Group A Residential Building, Sub-Division A-3 Dormitories and A-4 Apartment Houses** of M/s. Government Medical College Hospital, existing hospital building consists of Government College Hospital Block, Faculty Block and Quarters Blocks. The Government Medical College Hospital Block consist of ground floor + 6 floors with the height of 27.58 meters. CRRQ Quarters for female block is ground floor + 3 floors with a height of 14.90 meters. CRRQ Quarters for male block is ground floor + 3 floors with a height of 14.90 meters. RMO & ARMO Quarters block is ground floor + 1 floor with a height of 8.0 meters. Nurse hostel block is ground floor + 1 floor, Mechanical laundry area is

to inform
Coordinator
Quality
manager

Seen
3.2.25

ground floor with a height of 5.10 meters, mortuary block is ground floor with a height of 5.0 meters, modern kitchen block is ground floor & cylinder room height is 4.4 meters at S.F.No.351/1, 354/2A, 361, Siluvampatty, Namakkal District subject to the following conditions and such other conditions as may be prescribed from time to time. This licence is valid for **THREE YEARS** from **28.01.2025** to **27.01.2028** and should be renewed on **28.01.2028**.

CONDITIONS

1. Periodical maintenance should always be ensured to keep all fire protection equipment and systems in good working condition.
2. "Mock drill" should be periodically conducted. The date of conduct should be informed to the District Officer, Namakkal District well in advance to enable the team to make suggestions, if any.
3. Trained fire personnel should be available to operate the systems in case of any emergency.
4. All fire fighting equipment should always be kept in good working condition at all times.
5. Any erection of a permanent or temporary structure should be intimated to this Fire and Rescue Services Department.
6. With reference to air-conditioning it should not exceed the electricity board load on any account.
7. Available set back area 7 meters on all sides should be maintained to withstand the weight of 45 tons of fire fighting vehicle.
8. House keeping / dumping of waste material any where should be avoided. Dust bins should be cleared everyday.
9. Emergency fire exit, door should open from the floor to staircase only and not the other way round. The door should be in red reflector & arrow marks should commensurate with the gradient of staircase.
10. Do's & don'ts in times of emergencies should be available in a laminated hanging pad or otherwise in the telephone operator's desk as well as in the CE or emergency in charge of the officer's desk.
11. Alternate staircase should be kept free without any obstruction.
12. All staircases should be kept open during office hours and should be kept usable at any point of emergency.
13. Fire order / contingency plan should be prepared and displayed in each floor. It should also contain the rescue team members name, designation and contact number.
14. As per section 3.2 of BIS 12459, 1988 - code of practice for fire safety in cable regularization, 1m transparent fire retardant

coatings shall be applied to all cables at termination points in electrical panels and all cables inside the distribution boxes.

for Director,
Fire and Rescue Services,
Tamil Nadu.


To:
M/s. Dr. R. Gunasekaran MD., DM.,
Dean (FAC),
Govt. Medical College and Hospital,
Namakkal.




Copy to:
The Deputy Director, Fire and Rescue Services,
Salem Region, Salem.

CONSTRUCTION OF NEW GOVERNMENT MEDICAL COLLEGE AND HOSPITAL FOR INTAKE OF 150 MBBS STUDENTS IN NAMAKKAL DISTRICT.

FIRE FIGHTING ARRANGEMENTS



S.NO	NAME	AREA SQ.M
1.	HOSPITAL G+6 FLOORS	36229.00
2.	FACULTY G+5 FLOORS	25210.00
3.	AUDITORIUM G+1	3107.39
4.	MORTUARY G	439.00
5.	STP & ETP	
6.	MECHANICAL LAUNDRY	412.60
7.	CAFETERIA G	302.75
8.	C&D TYPE QRS STILT+4	3144.50
9.	A TYPE QRS STILT+4	2592.50
10.	BOYS UG HOSTEL STILT+5	6782.00
11.	CRRI MALE G+3	1066.40
12.	RESIDENT MALE QRS G+2	840.56
13.	RESIDENT FEMALE G+2	840.56
14.	CRRI FEMALE G+3	1066.40
15.	GIRLS UG HOSTEL STILT +5	6782.00
16.	NURSES HOSTEL G+1	1713.00
17.	RMO & ARMO QRS G+1	418.78
18.	DEAN QRS G+1	279.60
19.	BIO MEDICAL WASTE	44.10
20.	KITCHEN	266.97
21.	FIRE PUMP ROOM	118.40
22.	HT PANEL ROOM	332.71
23.	ADMINISTRATIVE BLOCK	1380.00
24.	MANI FOLD ROOM	258.52
25.	WAITING SHED	
26.	PAY AND USE TOILET	54.50

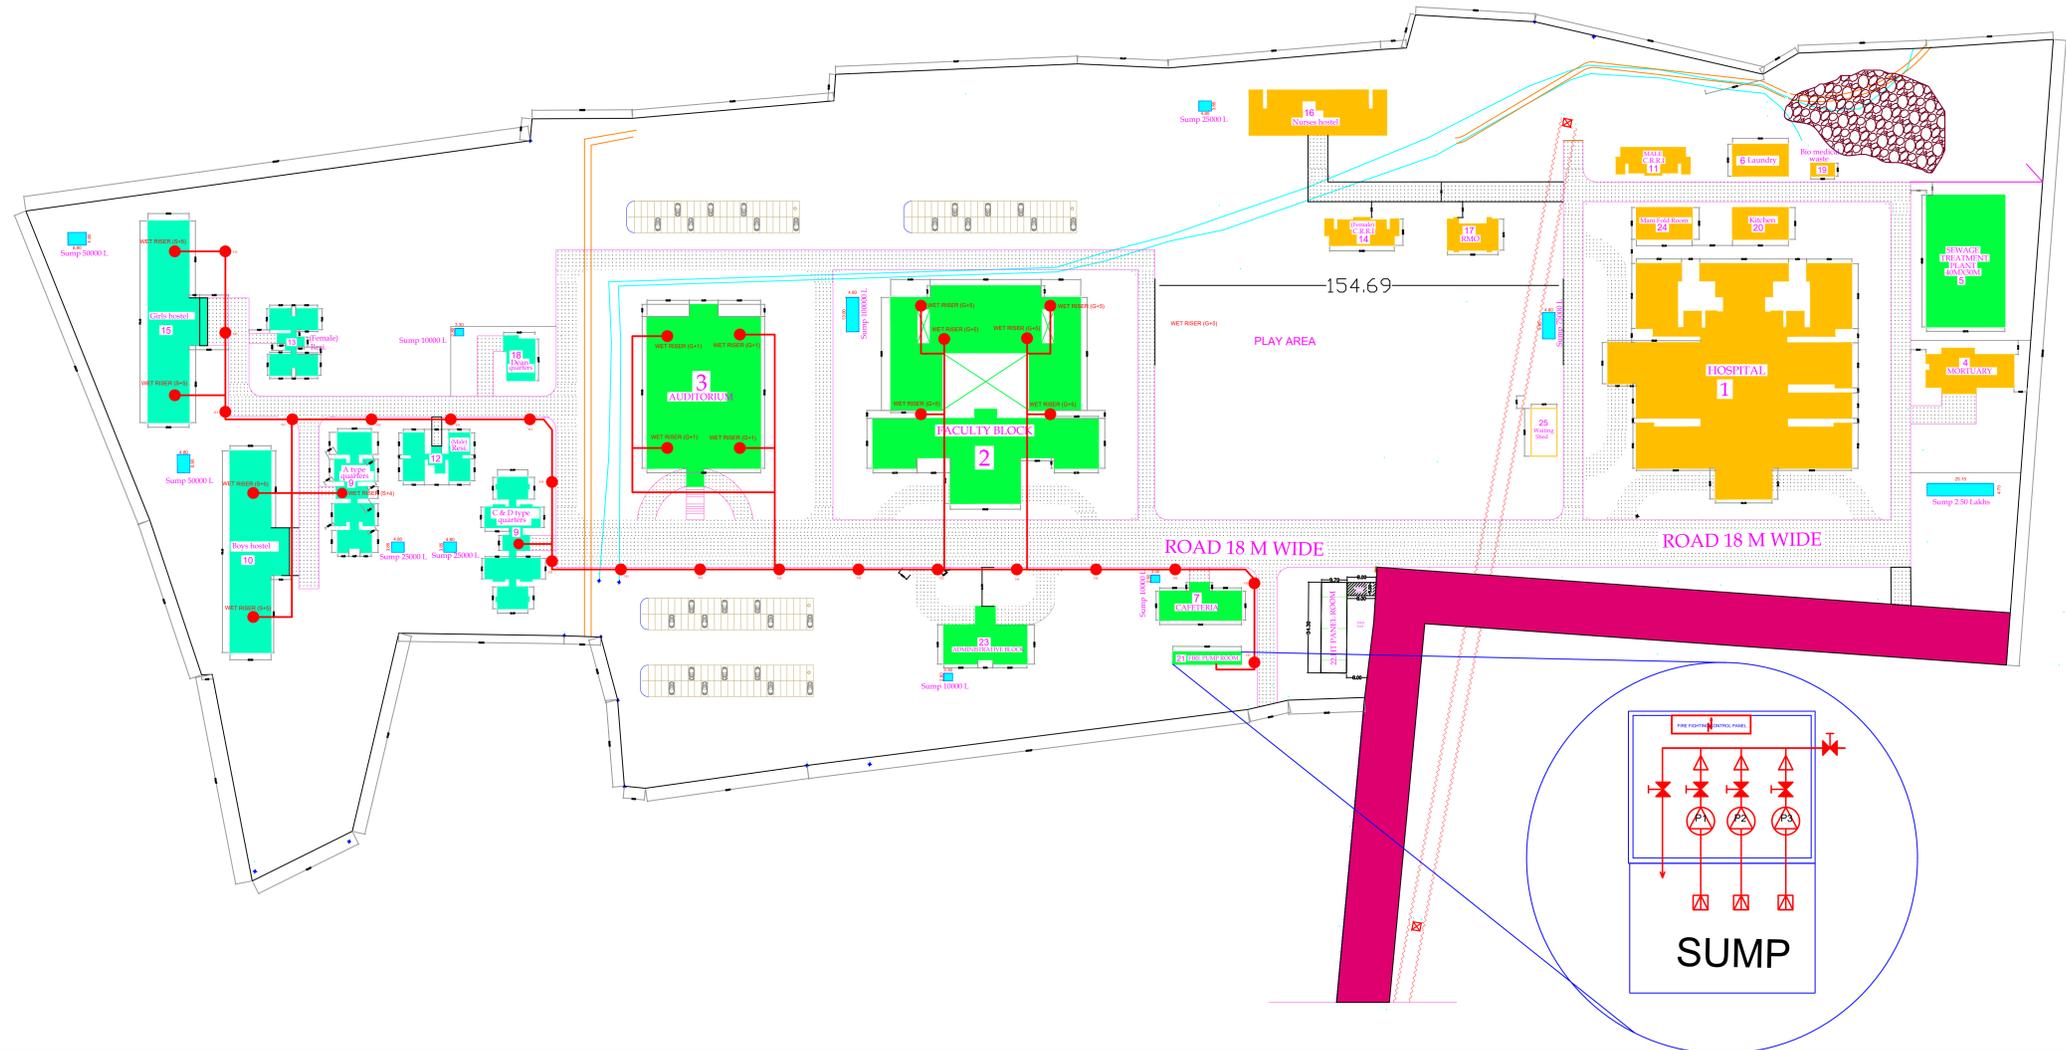

LEGEND	
SYMBOL	ABBREVIATION
	FIRE PIPE LINE
	FOOT VALVE
	DIESEL ENGINE FIRE PUMP
	MAIN ELECTRIC FIRE PUMP
	PRESSURISATION PUMP
	SLUICE VALVE
	NON RETURN VALVE
	HOSE REEL DRUM
	HYDRANT VALVE
	YARD HYDRANT VALVE
	HOSE BOX WITH HOSE & BRANCH PIPE
	FOUR WAY FIRE BRIGADE INLET
	AIR RELEASE VALVE